



ROOF FRAMING PLAN scale: 1/8" = 1'-0"


- NOTES:
1. ROOF SHALL BE 4-PLY BONDED TYPE BURRUM ROOFING W/ GRAVEL TOPPING ON 1" RIGID INSULATION & 1/2" DEEP 22 GAGE STEEL DECK CONT. OVER 3 SPANS & WELDED @ 2" @ EACH BEARING. PROVIDE WELDING WASHERS.
 2. BRACING SHALL BE 1/4" x 1/2" x 1/8" L HORIZONTAL BRIDGING TOP & BOTTOM - WELDED. NUMBER OF ROWS SHALL BE AS INDICATED ON PLAN.
 3. TOP OF STEEL BEAMS SHALL BE (2 1/4") FROM TOP OF STEEL JOISTS. TOP OF STEEL JOISTS SHALL BE 10" ABOVE FINISHED FLOOR AT FRONT WALL & 17" @ REAR WALL.
 4. FRAME ALL ROOF OPENINGS W/ 4" x 4" x 3/16" LG UNLESS OTHERWISE NOTED.

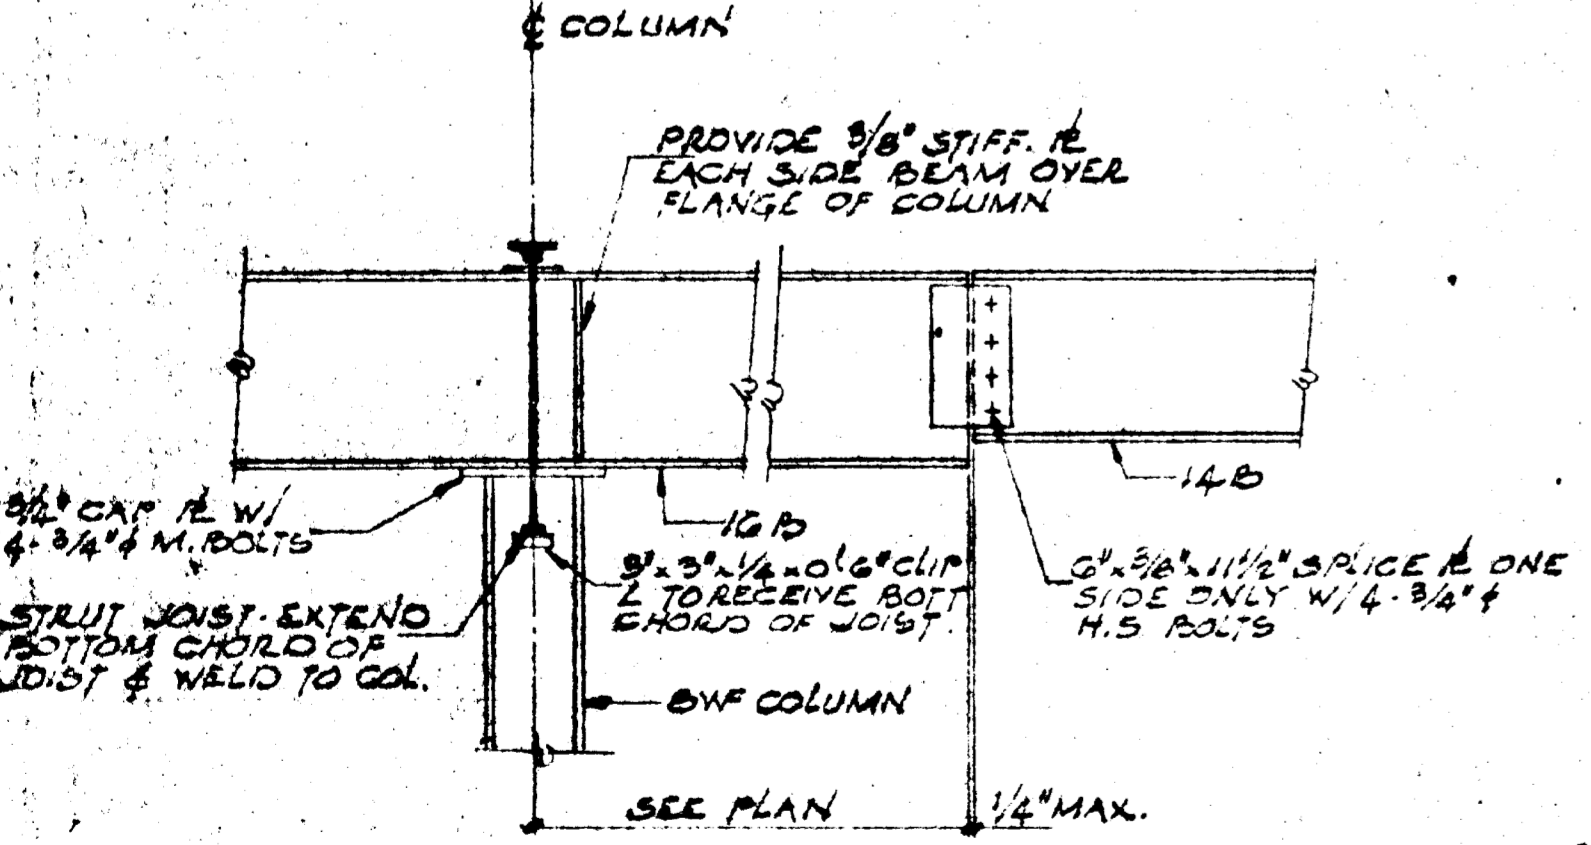

CANTILEVER BEAM DETAIL no scale

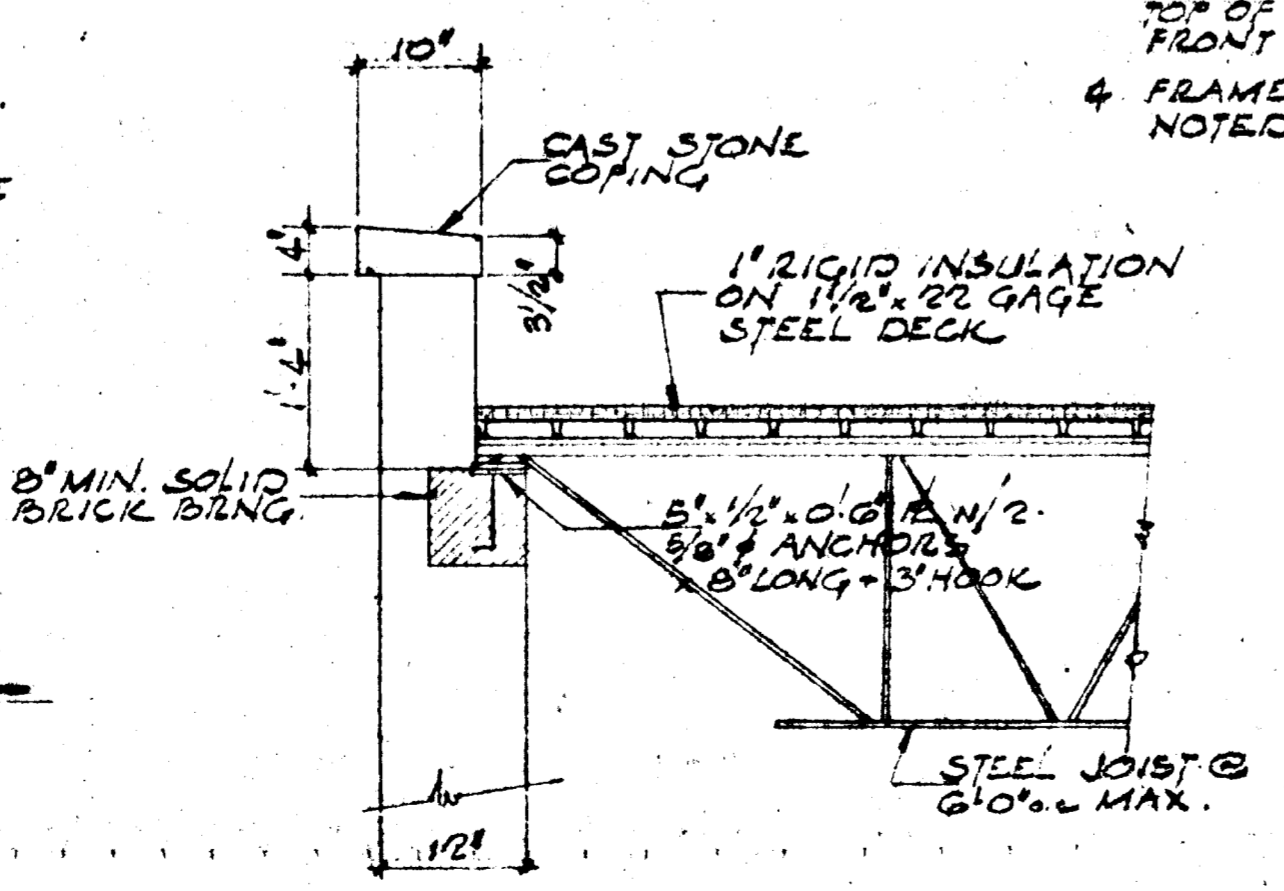

SECTION S2-1 scale: 3/4" = 1'-0"

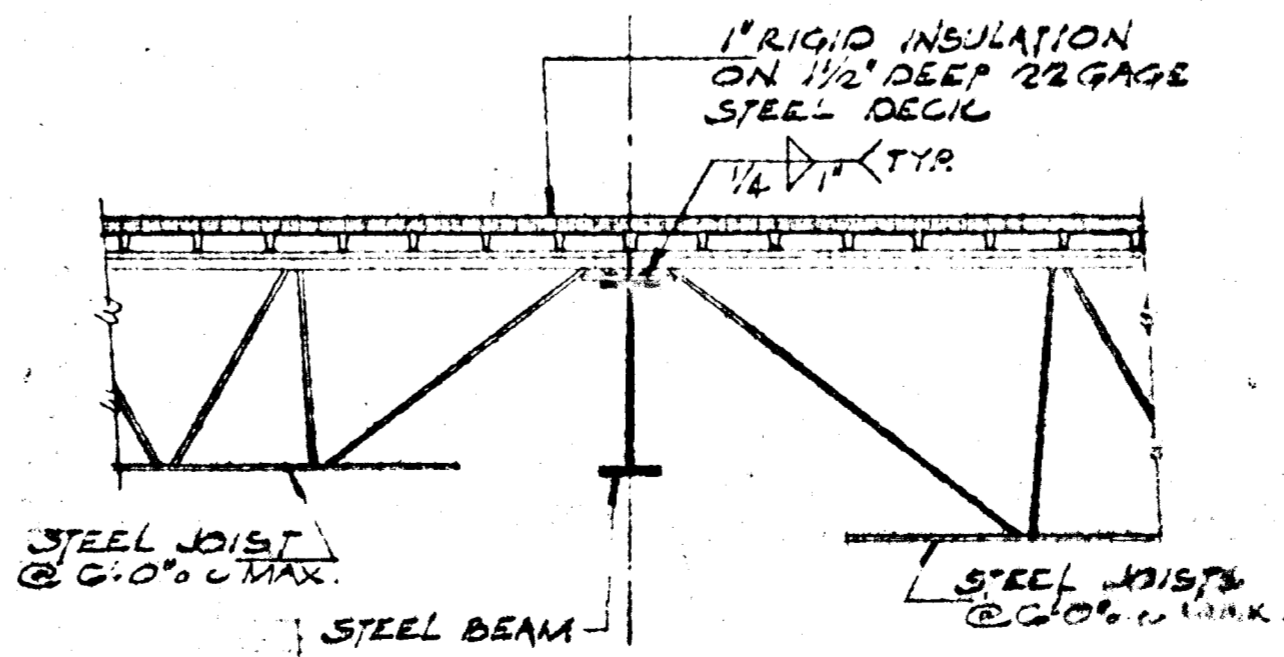

SECTION S2-2 scale: 1/2" = 1'-0"

REVISIONS NO BY DATE 1 JIM 6-19-63			OWNER MARTIN INDUSTRIAL PARK VENTURE 1609 CONNECTICUT AVE WASHINGTON D.C.		DRAWN G
			A WAREHOUSE FOR MARTIN INDUSTRIAL HYATTSVILLE INDUSTRIAL EDMONSTON P.G. CO., MARYLAND		CHECKED J.M. APPROVED
DATE 30 APRIL 63			SCALE AS NOTED		SHEET N° 5
CONSULTING ENGINEER MACRIS & SIMKO 817 SILVER SPRING AVE. SILVER SPRING, MD. 20910 (301) 585-0000			WASHINGTON D.C.		DRAWN G.B. 11