


PLUMBING — HEATING AND VENTILATING

NO SCALE

Note
 Entire warehouse area shall be sprinklered in accordance with N.F.P.A. pamphlet #13 and all applicable codes of Prince Georges County. Sprinkler shall be "wet system"

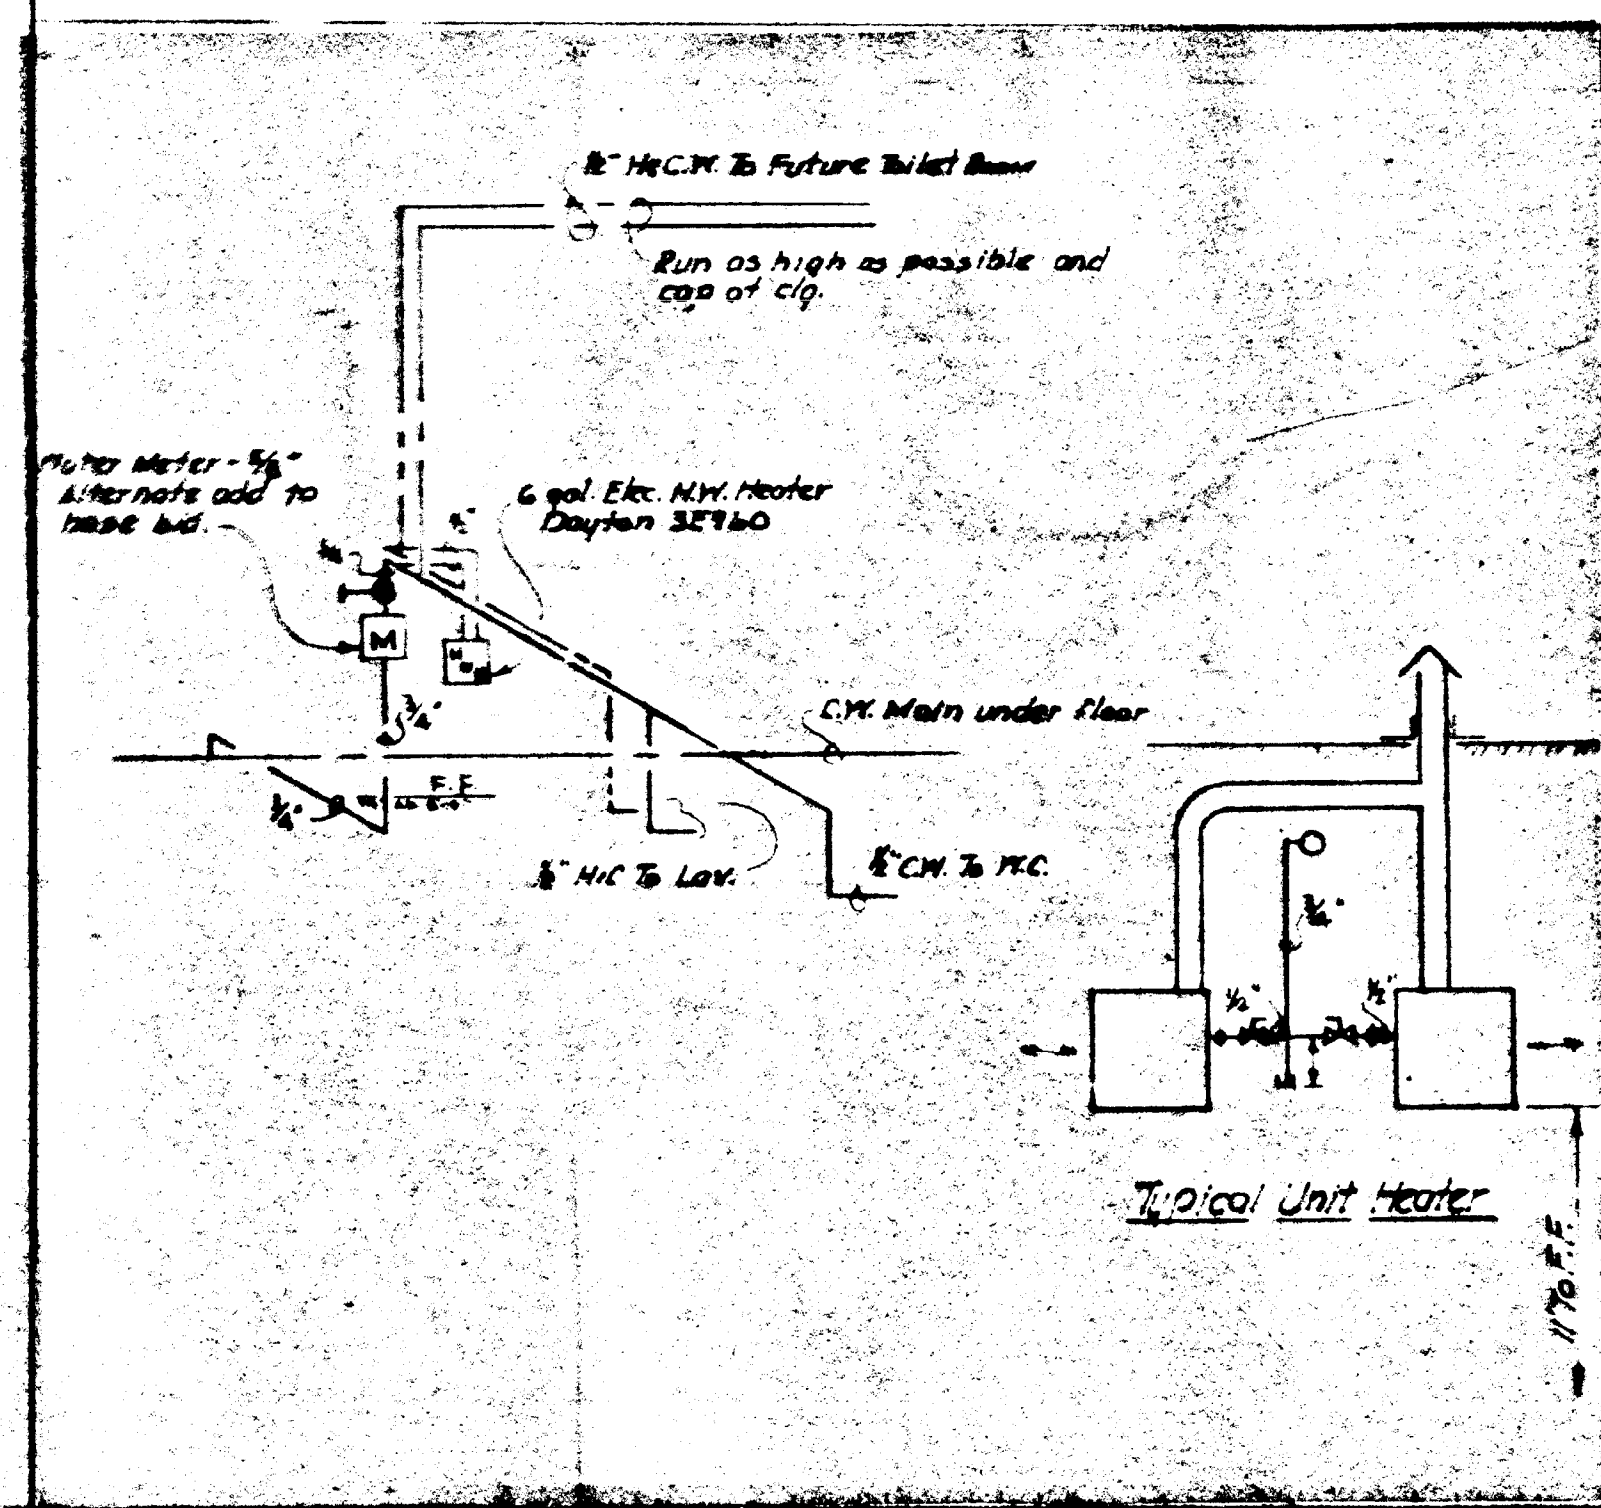

GAS UNIT HEATER SCHEDULE			PLUMBING FIXTURES + MATERIALS	
N ^o .	BTU. OUTPUT	MODEL OR EQUAL	WATER COSET	AMERICAN STD. F. 2120 CABET W/SEAT + COVER
1	50,000	JANITROL UNIT 68-108	LAVATORY	F. 124 CONCRETE SINKS W/2-5/8" SINKER
2	40,000	" " " 68-099	TWEL. CABINET	BOBICK 19-207-C
3	50,000	" " " 68-070	PAPER HOLDER	HALL MARK - 071

Notes
 1. Underground sanitary vent to be sensor weight C.I.
 Above ground sanitary and vent to be galv. steel pipe with
 1/2" drainage fittings of 2 1/4" copper.
 2. Underground water to be type "K", above ground to be
 type "L" copper.
 3. Gas pipe to be 1/2" steel with 1/2" malleable fittings.

Note
 Unit heater supports shall be attached to the top chord
 of roof truss. Where hung together, each pair
 of unit heaters shall be attached to three joints.

PROPOSED			
WAREHOUSE NO. 3A			
HYATTSVILLE INDUSTRIAL EDMONSTON-PRINCE GEORGES COUNTY-MARYLAND			
REVISIONS		MARTIN INDUSTRIAL PARK VENTURE 2045 University Blvd E. Adelphi, Maryland	MACRIS AND SIMKO Consulting Engineers 817 Silver Spring Ave. Silver Spring Md.
			Job No. SHEET 6 Date 5-2-66