


Grade Area as necessary to construct building wall. Retain all adjacent areas to conditions equal prior to construction. See wall sections, sheet 1, for drainage plane details.

SITE PLAN

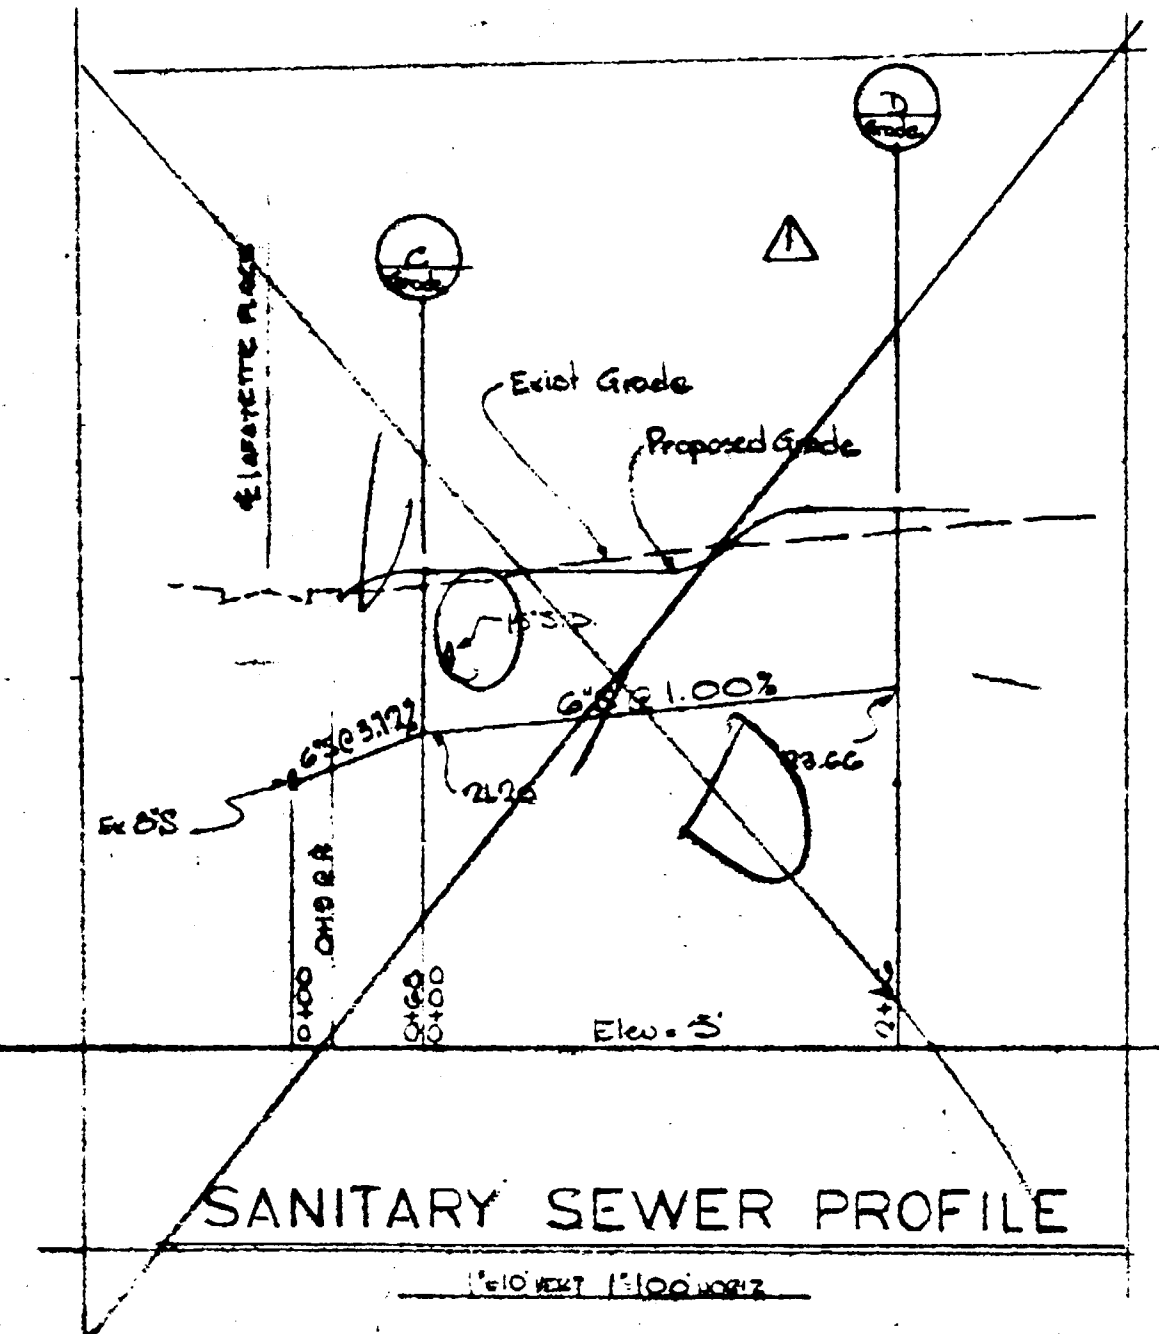

SANITARY SEWER PROFILE

GENERAL: Includes in furnishing of all labor, equipment, and materials necessary to construct a new masonry structure. The contract for erection of the building shall be prepared and executed in accordance with the "Standard General Conditions of the Construction Contract," of the National Society of Professional Engineers. Copies of this form are available on demand from the office of the Engineer.

DESIGN CRITERIA: A.S.T.M. Manual (1963); A.C.I. Manual (1963); B.O.C.A. Code (Latest Edition).

EXISTING CONDITIONS: All existing conditions and dimensions shall be determined and verified in the field prior to fabrication of any materials.

ROOF: Roof - 30 psf; Warehouse floor - 250 psf; stairs - 100 psf.

SOIL VALUE: In compliance with Section 725.0 as amended, we have made an investigation of the proposed site for this project. In conjunction with soil boring information supplied by George A. Oliver, in our opinion the soil is capable of sustaining a superimposed load of 4000 psf. The soil is sandy clay and clayey sand. Final bearing value shall be ascertained at time of footing excavation.

FOUNDATIONS: To be minimum of 2'-0" below finished grade and bearing on undisturbed soil 1'-0" below original grade. All footings not shown will be 12" thick and project 6" each side.

FOUNDATIONS: Where required shall be placed in strict accordance with the Prince Georges County Building Code and applicable A.S.T.M. Specifications. All fill shall be placed under the direction of a qualified Foundation Engineer and Testing Laboratory. Field inspection reports are to be filed with the structural engineer.

BACKFILL: All backfill to be compacted by means approved by the engineer in 6" layers. Compacted fill prior to laying of the floor slabs shall have a density and compressive value of not less than 95% of the normal undisturbed soil value, which shall be determined by an approved testing laboratory as prescribed by the pertinent A.S.T.M. Specifications.

EXCAVATION: The contractor shall be responsible for providing adequate vertical and horizontal supports of adjacent buildings, excavation and utilities. Grade all areas to drain.

CONSTRUCTION LOADS: The contractor shall see for and obtain the Engineer's approval before placing on the structure any loads greater than the above design loads.

CONCRETE: In general to conform to the A.C.I. Building Code Requirements for Reinforced Concrete (1963). Concrete for slabs shall have a compressive strength of 3000 psi @ 28 days, with 6 bags of cement per cubic yard, and 6 gallons of water per bag of cement. Footing concrete shall be 2500 psi, with 5 1/2 bags of cement per cubic yard. Maximum slump 3".

CONCRETE PROTECTION: Reinforcing steel to have the following minimum concrete cover: Footings - 3"; slabs - middle of slab.

REINFORCING STEEL: All reinforcing steel shall be new, high strength billet steel conforming to A.S.T.M. Specifications A-602 and A-603 (min. 70 - 60,000 psi). All reinforcing steel shall be carefully fabricated and placed in accordance with the latest edition of the A.C.I. Manual of Standard Practice.

WELDED STEEL: To conform to A.S.T.M. Specification A-155, and to be placed as indicated on the drawings. Lap seams at least 6" in each direction.

STRUCTURAL STEEL: In general to conform to A.S.T.M. Specification A-36. All steel shall be carefully fabricated and erected in accordance with the latest edition of the A.S.T.M. Manual. All connections shall develop the full strength of the beams, in general, field connections shall be made with 3/4" high strength bolts (A-325), and shop connections shall be welded. Frames all openings in roof with 4" x 4" x 5/16" angles, unless otherwise noted. All structural steel shall be painted one shop coat of light colored zinc chromate. Minimum bearing plates shall be 4" x 4" x 5/8", unless otherwise shown.

STEEL JOISTS: All steel joists shall conform to the latest S.J.I. Specifications, and the Prince Georges County Building Department, in all respects. Joists shall be welded to steel supports with 1/4" welds, 1" long.

METAL ROOF DECK: To be 1 1/2", 22 gauge, galvanized or painted. Deck shall extend over eaves supports, and shall be capable of supporting a minimum uniform load of 50 psf. Metal deck shall be manufactured by a member of the Steel Deck Institute, and shall be installed in strict accordance with the specifications of the Steel Deck Institute.

LINTELS: Unless otherwise indicated, provide loose angle lintels as follows, with spacing for each 4" of masonry, with 3 1/2" leg horizontal and 6" minimum bearing each end:
 opening to 3'-0" - 3 1/2" x 3 1/2" x 1/4" L
 3'-1" to 5'-0" - 4" x 3 1/2" x 5/16" L
 5'-1" to 8'-0" - 4" x 3 1/2" x 3/8" L
 4'-0" to 8'-0" - 6" x 3 1/2" x 3/8" L
 Openings greater than 8'-0" - 8B13 with suspended 5/16" plate and minimum of 8" bearing each end. Lintels over openings in interior masonry walls, not otherwise specified, shall be pre-cast, lightweight concrete lintels with - 1-#5 bar top and bottom for each 4" width.

STEEL INSPECTION: Field structural steel to be inspected by qualified inspectors approved by the structural engineer. Field inspection reports to be filed with the structural engineer within 5 days of the time of actual inspection. Inspectors must be notified of all phases of construction and welding by the general contractor.


APPROVAL OF SHOP DRAWINGS: Shop drawings for all structural items mentioned above are a part of the structural design of this project, and must be submitted to and approved by this office. If a contractor or owner fails to obtain our approval of the shop drawings, we will not be responsible for the structural design of this project.

SOIL BORING LOGS

BORING NO. 8	GROUND SURFACE	ELEV. = 31'	DEPTH	BLOWS
0'-15"	FINE GRAY BROWN SAND TRACE CLAY		3'	15
			5'	18
			8'	16
			10'	31
			13'	26
			15'	17

BORING NO. 9	GROUND SURFACE	ELEV. = 30'	DEPTH	BLOWS
FILL				
BROWN LOAMY CLAY			3'	4
BROWN GRAY LOAMY CLAY			5'	10
FINE BROWN CLAYEY SAND			8'	9
COARSE BROWN SAND & GRAVEL TRACE CLAY			10'	6
0'-15"	FINE BROWN GRAY SAND, TRACE CLAY		11.5'	5
			13'	45
			15'	30

BORING NO. 10	GROUND SURFACE	ELEV. = 32'	DEPTH	BLOWS
FILL				
0'-11"			3'	9
			5'	26
			7.5'	26
			10'	14
			12'	23
			15'	45

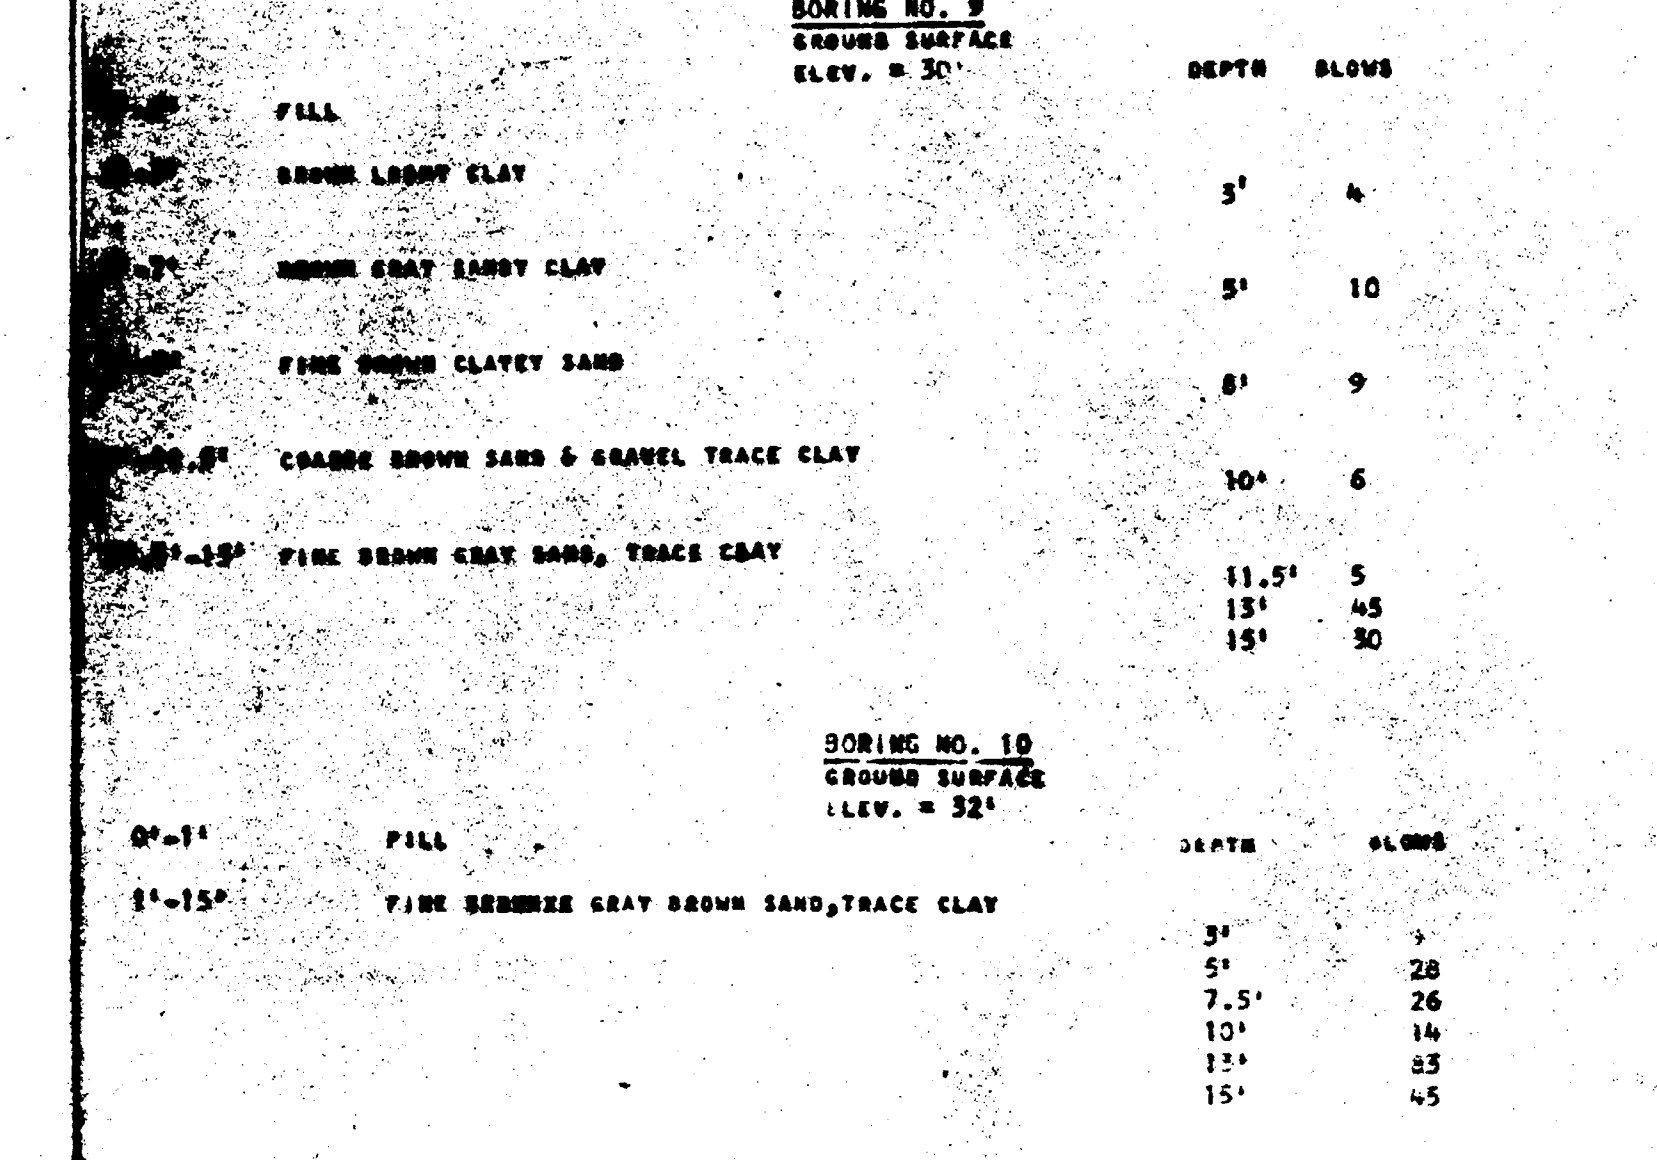

PARKING AREA PAVING SECTION

PAINTING AND FINISHES: The contractor shall furnish all labor and materials necessary for the painting of the following areas:

- All doors, trim and moldings to receive two coats of semi-gloss paint.
- All drywall to receive two coats of latex base paint. Drywall partition above entrance stairway will not be painted. Drywall at entrance soffit shall receive 2 coats of semi-gloss paint.
- All interior masonry in bathrooms to receive two coats of latex base masonry paint.
- All galvanized roof leaders and eavepipes shall receive one coat of galvanized metal primer, and one coat of semi-gloss paint. Cast iron roof leader extensions shall be primed and painted to match.
- All exposed exterior block masonry walls shall receive one coat of "Spraycrete" or approved equal.

MASONRY: Clay facing brick shall conform to A.S.T.M. Specification C-112-67, oversize (5 courses per 2 block courses). Allow \$32.00 per tonnage. All masonry construction shall be in accordance with the American Standard Building Code Requirements for masonry. Masonry construction shall be constructed of 75% solid, lower-bearing masonry units. Isolated piers and pilasters shall be constructed of clay bricks with a minimum strength of 4500 psi, unless otherwise noted.

Provide #3 duro-wall or equivalent in all masonry walls every other block course (i.e. 6" o.c. vert.) unless noted otherwise. Above and below wall openings place duro-wall at 6" o.c. for two block courses. Provide 3 courses of solid brick or 100% solid masonry below all lintels and above all bearing beams. Brick piers shall be fully bonded into adjacent walls. Unless otherwise specified in plans, all masonry shall conform to the following specifications:

- Hollow load-bearing concrete masonry units - A.S.T.M. - C-90-67
- Hollow non-load bearing concrete masonry units - A.S.T.M. - C-129-64T
- Solid load-bearing concrete masonry units - A.S.T.M. - C-145-66T
- Facing brick - A.S.T.M. - C-216-67
- Mortar (Type "M"-750 psi) - A.S.T.M. - C-270-64T
- (Type "M"-2500 psi - below grade) - A.S.T.M. - C-270-64T

DRAINAGE: The contractor shall furnish all labor, materials and equipment for roof and parking lot drainage, including but not limited to the following:

- Thru parapet galvanized roof eavepipes
- Galvanized leaders and cast iron leader extensions
- Concrete drainage pipe along building wall
- Parking lot drainage manholes
- Connection to existing storm drain inlet

Permit for field connection shall be obtained by the Engineer.

FINISHES: The contractor shall furnish all labor, materials, equipment and connection fees necessary to complete and leave ready for operation the plumbing system, in accordance with the plans and all applicable codes, including but not limited to the following:

- Sanitary waste collection system
- Sanitary sewer system and connection
- Fire sprinkler main and connections and including the fire alarm pull station in the building walls
- Plumbing fixtures and hot water heater
- Individual interior water meters not included in this project
- All necessary gas connecting and piping system

ALTERNATE BID: The contractor shall furnish all labor, materials, equipment and connection fees necessary to complete and leave ready for operation all the plumbing and equipment with all piping and all materials and labor included in the alternate bid following:

- Payment of proper permit fees and related costs for plumbing permits
- All electrical fixtures, wiring and bath accessories
- All lighting fixtures
- All gas fired space heaters
- Wiring of electrical equipment furnished and installed by others

FIELD MEASUREMENT: All stud walls shall be constructed of masonry blocks. Stud walls shall be 1/2" firecode masonry, recessed, with taped joints. Taped joints shall be at all outside corners.

WATER AND SEWER NOTES

- A sanitary sewer shall be installed in accordance with the latest U.S.S.C. standards and specifications.
- Construct manhole rim elevations to match ground surface elevation and elevation of sewer connection and before construction of on-site utilities.
- All 6" sewer shall be C.S.P.W. or V.C.P.W. at the building floor to a point 5' of free fall. All 8" and 10" sewer shall be vitrified clay pipe.
- 6" and 8" water main shall be C.I. or C.P. and shall be installed with a minimum of 3" cover.
- 6" and 8" water shall be copper type 2.
- Block all tees and caps with concrete per U.S.S.C. Section 40715-1.

INDEX OF DRAWINGS

NO.	DESCRIPTION
1	SITE PLAN, STRUCTURAL NOTES, FOUNDATION & SOILING LOGS
2	FOUNDATIONS - DETAILS
3	PAVING PLAN - SCHEDULE
4	SECTIONAL CONNECTION DETAILS
5	WALL SECTION - FOOTINGS
6	WALL SECTION - FOUNDATION
7	DOOR FRAME CONNECTION DETAILS
8	MECHANICAL CONNECTION DETAILS

PROPOSED WAREHOUSE NO. 4

REVISIONS

NO.	DATE	DESCRIPTION
1	JUN 6-7-70	ISSUED FOR PERMIT

APPROVED: [Signature]

DATE: JUN 6-7-70

PROPERTY DESCRIPTION
 LOT 10, BLOCK B
 HOTTENVILLE INDUSTRIAL
 HOTTENVILLE, MONTGOMERY CO.

AREA TABULATION

GROSS PROPERTY AREA (LOT 10)	= 71,333 [±]
GROSS BUILDING AREA (WHS 4A)	= 50,450 [±]
REMAINDER REQUIRED (1 PER 1000)	= 20
PARKING REQUIREMENT	= 37

All parking spaces shall be 200' perpendicular, other 24' x 22' or 10' x 20'.